


- NOTES:**
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
 2. A MINIMUM CLEARANCE OF 500mm TO BE MAINTAINED TO IRISH WATER MAINS, ELECTRIC CABLES, STORMWATER MAINS, SEWER GRAVITY MAINS, GAS DISTRIBUTION MAINS AND ALL OTHER SERVICES AS PER IS 328:2021 AND GNI/AD/SP/007.
 3. MARKER TAPE TO BE DETECTABLE 300mm WIDE TAPE LABELLED "CAUTION BURIED GAS PIPE".

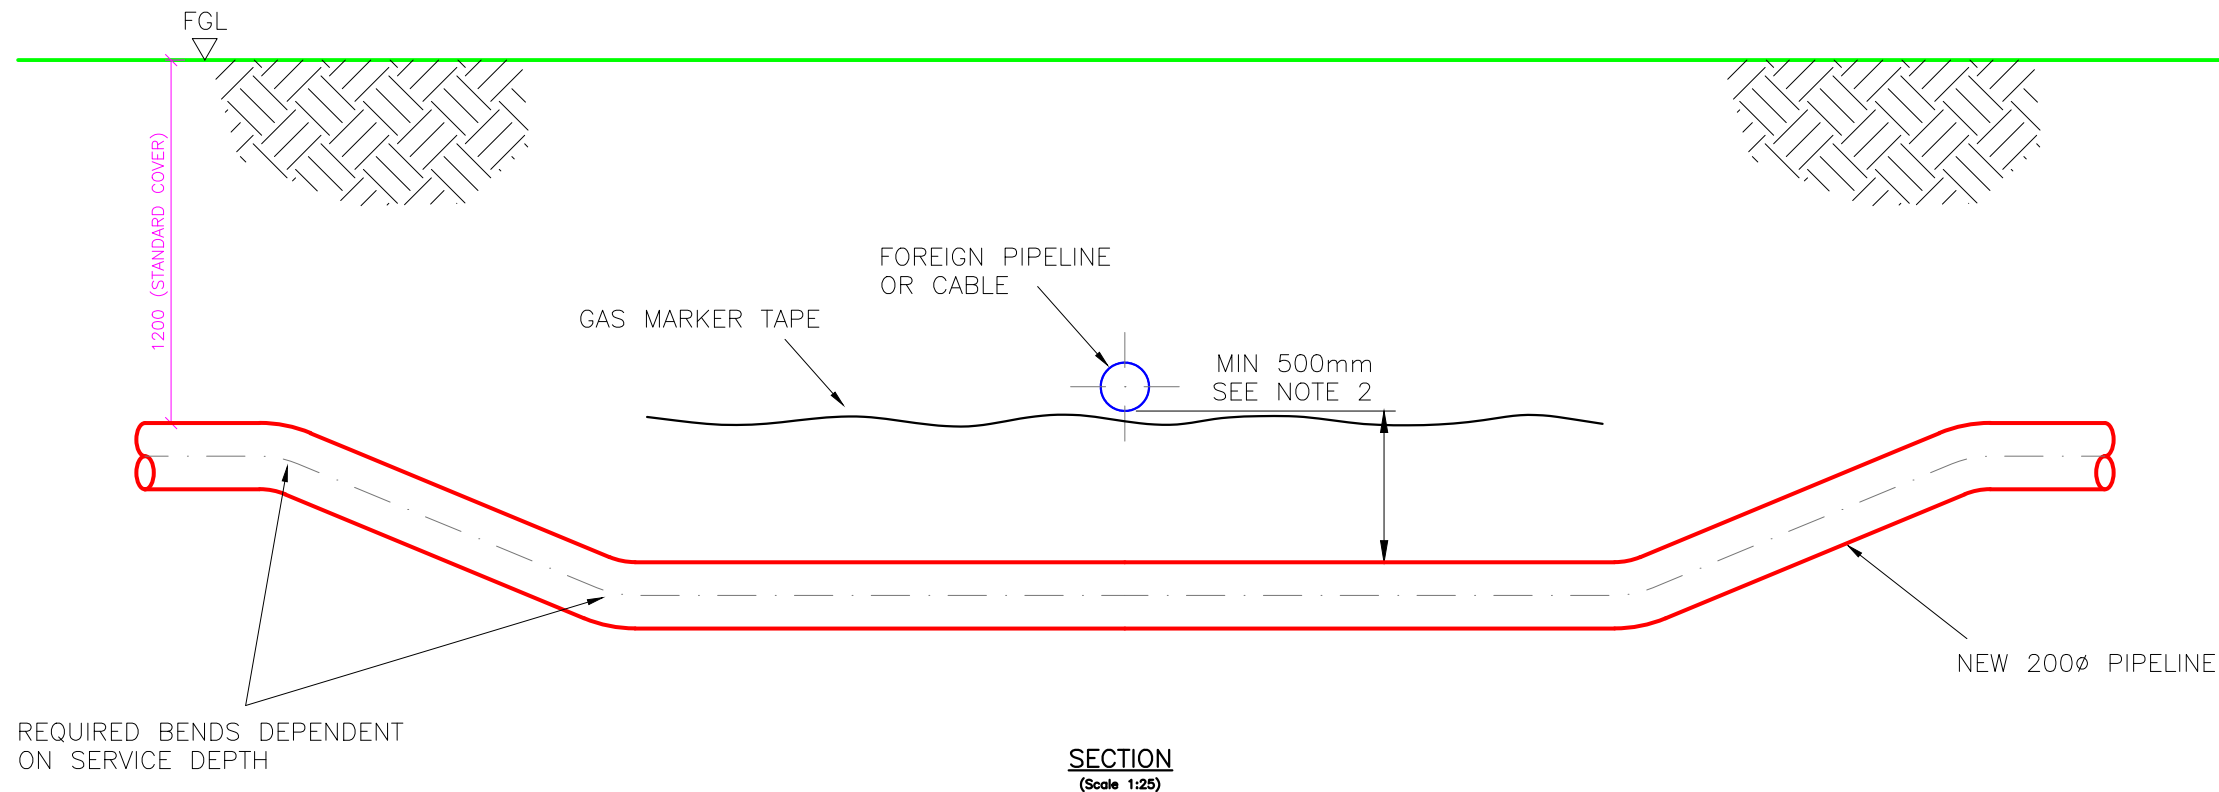

SECTION 39A APPLICATION

										APPROVALS			PROJECT Gas to Greener Ideas				
										A	DRAWING OFFICE	DRAWN BY D.MAILEY					
										B	DESIGN ENGINEERING	CHECKED T.MALONE					
										C	STRATEGY/PLANNING	APPROVAL C.SMITH					
										D	DESIGN MANAGEMENT	DATE 08/08/24					
										E	OPERATIONS						
										F	CONSTRUCTION						
										G	AM/AO ADDITIONAL						
A	SECTION 39A APPLICATION									DJM	TM	CS					
ISSUE	REVISION									REV. BY	A	B	C	D	E	F	G
CONSULTANT Bridge Street Centre Portlaoise Co. Laois Ireland T:(00353)(0)57 866 5400 www.fingleton.ie										Gas Networks Ireland			P.O Box 51, Gasworks Road, Cork, Rep of Ireland T +353 21 4534000				
										DRAWING NUMBER GNI138/MISC/001			SCALE AS STATED @A3		SHEET 01 OF 01		
										TITLE TYPICAL 3rd PARTY SERVICE CROSSING GNI138 Monksland Pipeline							